


# WELDED OR BOLTED FLANGE PIPE RISER (TOP RESTRAINED)

(ANCHORED AT TOP WITH NON-RESTRAINED SPRING INTERMEDIATE SUPPORTS AND VERTICALLY RESTRAINED SPRING ISOLATOR AT BOTTOM – WATER LOAD AT BASE)

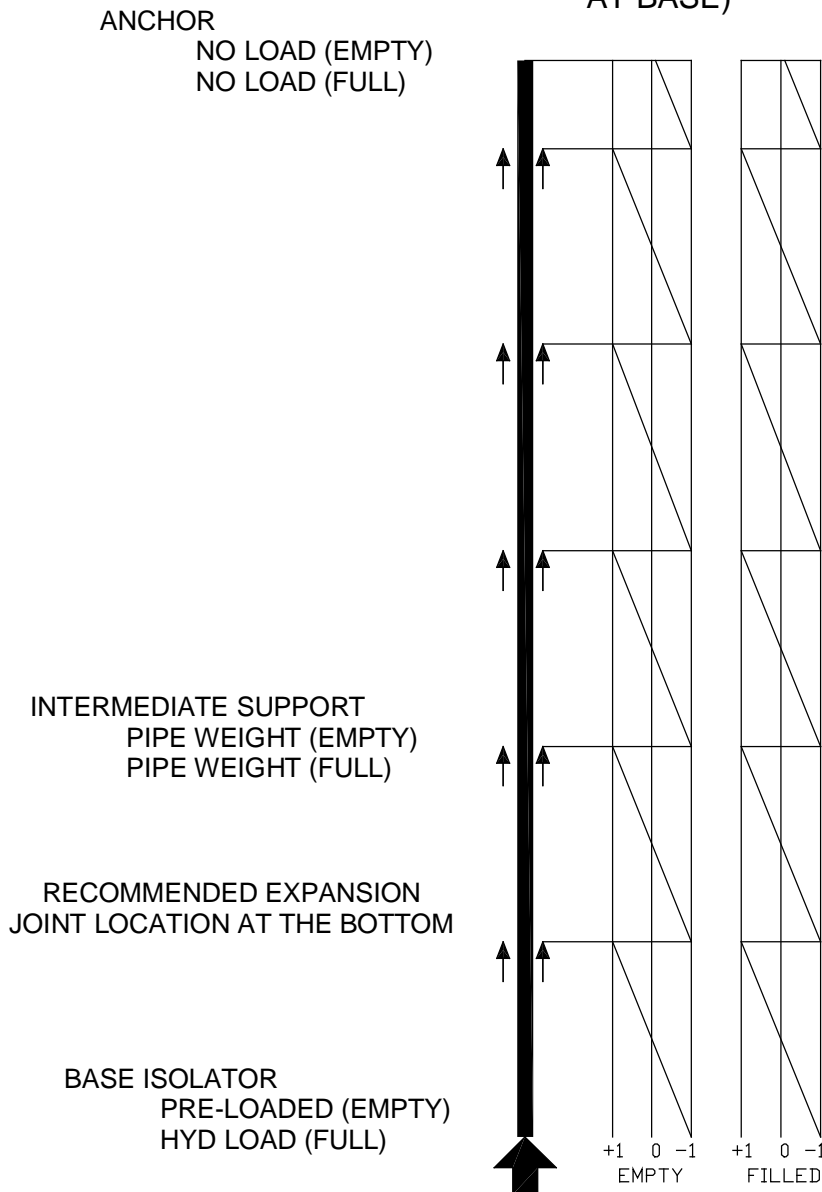

RELATIVE PIPE STRESS ASSUMING PIPE WT/FT AND WATER WT/FT IS APPROXIMATELY EQUAL (12' STD WT PIPE)

USE WITH CAUTION ON EXPANSIVE SYSTEMS  
DO NOT USE FOR CONTRACTIVE SYSTEMS

KINETICS™ Riser Design Manual

## CONC HYD LOAD / TOP RESTRAINED / SOLID COUPLING - TYPE 1

PAGE 1 OF 2



Toll Free (USA only): 800-959-1229  
 International: 614-889-0480  
 Fax: 614-889-0540  
 World Wide Web: www.kineticsnoise.com  
 Email: sales@kineticsnoise.com

DOCUMENT:

R1.2




# WELDED OR BOLTED FLANGE PIPE RISER (TOP RESTRAINED)

(ANCHORED AT TOP WITH VERTICALLY RESTRAINED SPRING PIPE SUPPORTS AT BASE AND INTERMEDIATE LOCATIONS – WATER LOAD DISTRIBUTED)

ANCHOR  
NO LOAD (EMPTY)  
NO LOAD (FULL)

INTERMEDIATE AND BOTTOM  
SUPPORT  
PIPE WEIGHT + PRE-LOAD (EMPTY)  
PIPE WEIGHT + LOCAL  
WATER WEIGHT (FULL)

RECOMMENDED  
EXPANSION JOINT  
LOCATION AT THE BOTTOM

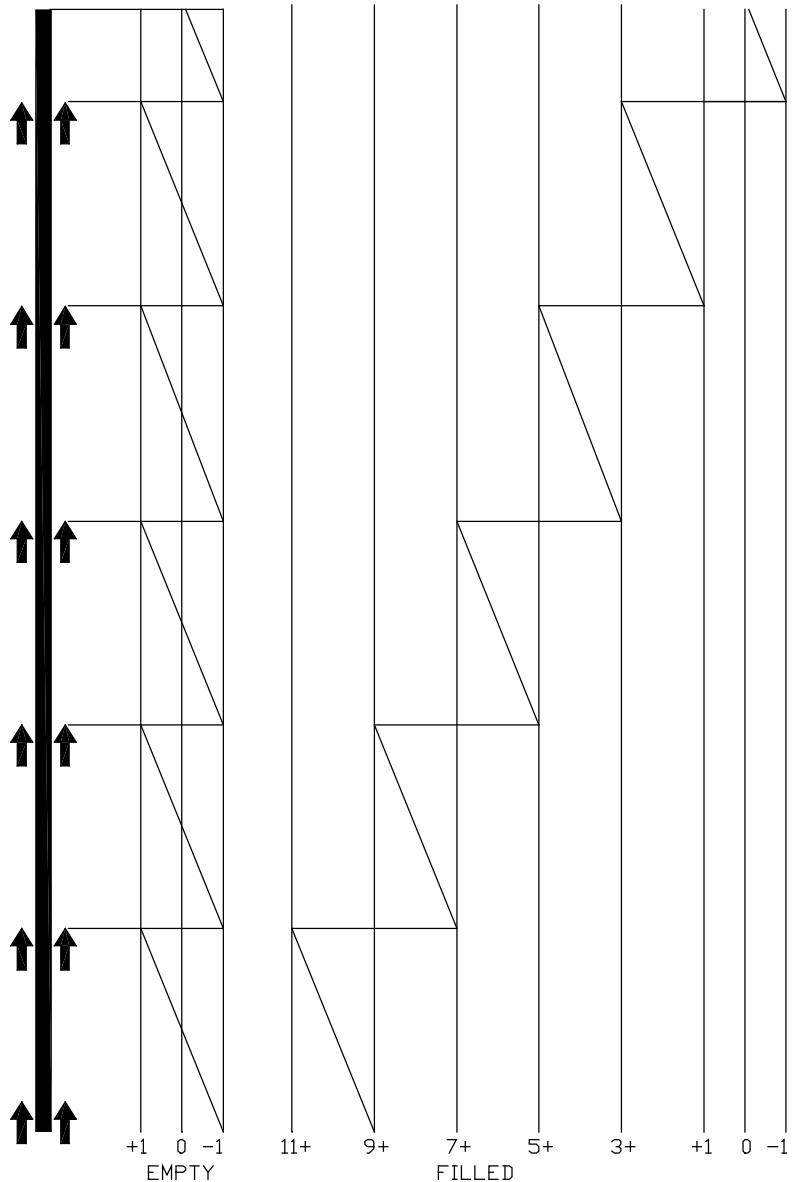

RELATIVE PIPE STRESS ASSUMING PIPE WT/FT AND WATER WT/FT IS APPROXIMATELY EQUAL (12' STD WT PIPE)

OK FOR EXPANSIVE SYSTEMS  
DO NOT USE FOR CONTRACTIVE SYSTEMS

KINETICS™ Riser Design Manual

## DIST HYD LOAD / TOP RESTRAINED / SOLID COUPLING - TYPE 2

PAGE 2 OF 2



DUBLIN, OHIO, USA • MISSISSAUGA, ONTARIO, CANADA

Toll Free (USA only): 800-959-1229  
International: 614-889-0480  
Fax: 614-889-0540  
World Wide Web: www.kineticsnoise.com  
Email: sales@kineticsnoise.com

DOCUMENT:

R1.2

